


# 2025

## Clark Regional Wastewater District

### Infiltration and Inflow Report For Salmon Creek Treatment Plant

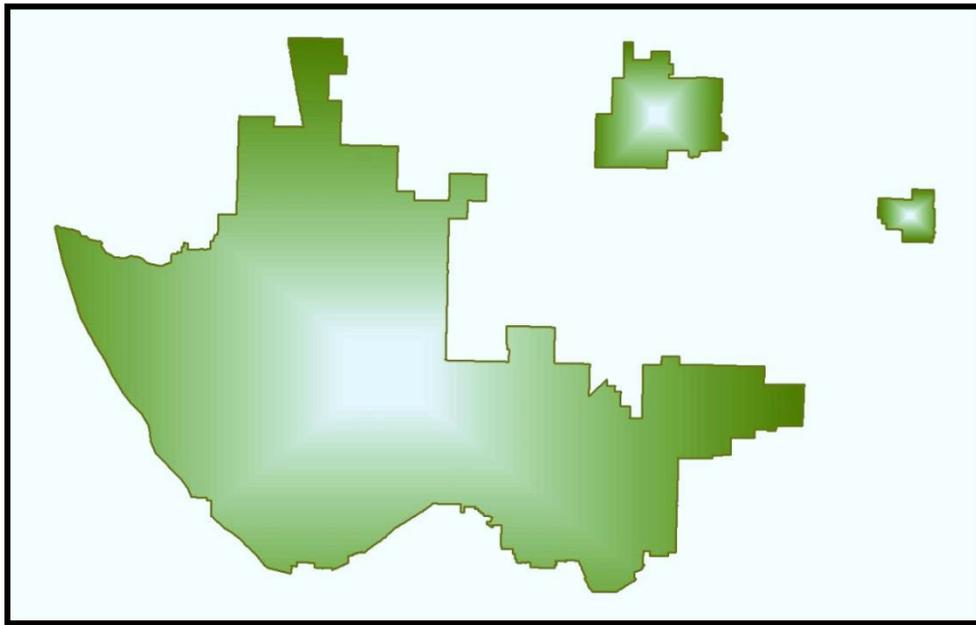


February 13, 2026

In Compliance with the NPDES Waste Discharge Permit  
No. WA0023639 Special Condition S4.E





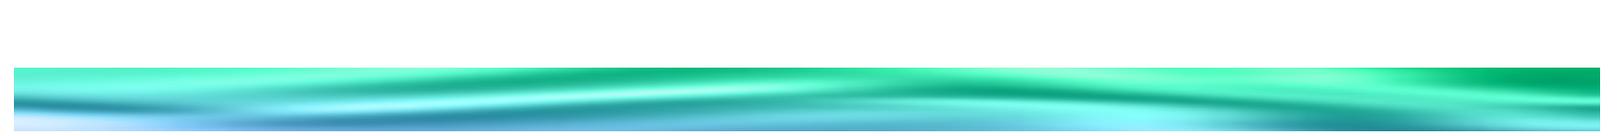

# TABLE OF CONTENTS

2025

Clark Regional Wastewater District  
INFILTRATION AND INFLOW REPORT

---

Overview ..... 1

Monitoring Program and Rehabilitation Projects ..... 3

**Appendix**

- Appendix A - Annual Infiltration/Inflow (I/I) Report (Ecology form)
- Appendix B - Flow Analysis Data
- Appendix C - Monthly Flow and Rainfall
- Appendix D - ERU and Sewer Line Data



# 2025 Infiltration and Inflow Report

## Overview

---

The Clark Regional Wastewater District (District) was formed in 1958. The District has always maintained a comprehensive construction specification, inspection and maintenance program to minimize infiltration and inflow (I/I) into the system. As a result, the system flow characteristics perform well below the non-excessive criteria as established in the EPA Infiltration/Inflow Analysis and Project Certification (Ecology publication 97-03).

Beginning in 2016, the District started conveying a portion of the flow generated in the City of Ridgefield service area to the Salmon Creek Treatment Plant (SCTP). Currently, all flow tributary to the Pioneer Canyon Pump Station is conveyed through the Discovery Corridor Wastewater Transmission System and ultimately to the Salmon Creek Treatment Plant. The average daily flow from the Pioneer Canyon Pump Station is about 0.66 MGD (4,365 Equivalent Residential Units (ERUs)). The Ridgefield Treatment Plant processes the remaining flow generated in Ridgefield. In addition, approximately 800,000 gpd (average daily flow) of District flow is sent to the Vancouver Westside Treatment plant. The District shifted an additional 530,000 gpd (average) to the Vancouver Westside Treatment plant from the Salmon Creek Treatment Plant from January 2025 through March 14, 2025. A pipe blockage in the system between May 15, 2025 and June 8, 2025 resulted in approximately 300,000 gpd (average) to be diverted to the Vancouver Westside Treatment Plant via an overflow structure. These flow adjustments associated with Salmon Creek are incorporated into this report.

The District completed the SCTP Phase 5 expansion project in 2025, which increased the plant's capacity. The updated design flows and population equivalents have been incorporated throughout this report (the 2025 Infiltration and Inflow Report). Additional detail is provided in the next section.

### **ANALYSIS**

The District's average dry weather and wet weather I/I rates are well below excessive. Average dry weather flows greater than 120 gallons per capita per day (gpcd) indicate excessive infiltration. Infiltration occurs during periods of high seasonal groundwater and dry weather with little or no rainfall. The District's infiltration remains well below excessive at 69 gpcd. Average wet weather flows greater than 275 gpcd indicate excessive inflow. Inflow occurs during periods of wet weather with significant rainfall, resulting in ponding and surface runoff. The District's inflow remains well below excessive at 131 gpcd.

For the purpose of this report, population calculations have been based on population equivalents. This method calculates a population based on the total number of ERUs multiplied by the planning assumption of people per ERU. Prior I&I reports assumed 2.43 people per ERU for the Salmon Creek Treatment Plant (per CH2M HILL, 2004 SCTP Phase 4). The calculation for population equivalent includes commercial and industrial ERUs in addition to residents of the area.



During the preparation of the 2025 Infiltration and Inflow Report relative to the new SCTP Phase 5 capacity improvements, staff recognized that the 2017 District General Sewer Plan assumed 2.66 people per ERU. The report and associated population equivalent calculations have been updated to reflect 2.66 people per ERU, rather than 2.43 people per ERU.

At the beginning of 2025, the Salmon Creek Treatment Plant served approximately 55,375 ERUs, with a population equivalent of roughly 128,005 (using 2.66 people per ERU) in the Salmon Creek tributary area, which includes the City of Ridgefield, with 4,365 ERUs, or a population equivalent of about 11,661 (using 2.66 people per ERU).

Appendix A shows that the District's 2025 I/I of 2.04 MGD represents an 85% increase compared to the 2003 base year. However, this base year has been used for many past I&I reports. To better understand I/I trends in the system, given various changes in the system configuration over time, the District reviews the average monthly flows and rainfall for the available records between January 1997 and December 2025. That data shows that 2000, 2013 and 2019 represent the lowest I/I years on record. The highest I/I (2.88 MPG) occurred in 2024 when the area received over 16 inches rainfall in December 2023 and January 2024. The District's I/I averaged 1.64 MGD over the past 25 years. Considering the generally consistent system response over the past 29 years and high rainfall amounts contributing to the high flow of 8.82 MGD in December 2025 as compared to the low flow of 6.79 MGD during the year, the 2025 I/I does not appear to be out of trend with historical performance. Also, the excessive inflow and infiltration calculations do not indicate that the system is experiencing higher than normal I/I.

TABLE 1

**1997-2025 I/I AND RAINFALL**

Year	Min of Average Monthly Flow (MGD)	Max of Average Monthly Flow (MGD)	I / I	Annual Rainfall
1997	3.9	5.73	1.84	48.18
1998	4.27	5.48	1.22	45.73
1999	4.2	5.92	1.72	43.87
2000	4.41	5.23	0.82	32.89
2001	4.39	5.74	1.35	36.41
2002	4.34	5.53	1.19	34.01
2003	4.63	5.72	1.1	41.02
2004	4.77	5.94	1.17	35.21
2005	4.79	5.9	1.11	34.82
2006	4.92	7.04	2.12	42.96
2007	5.12	6.64	1.52	34.14
2008	5.13	6.48	1.35	28.79
2009	5.11	6.39	1.28	31.93
2010	5.24	7.00	1.75	42.07
2011	5.05	6.99	1.95	30.77
2012	5.19	7.19	2.00	41.65
2013	5.32	6.39	1.07	21.19
2014	5.34	6.84	1.82	32.17
2015	5.31	8.06	2.75	39.44
2016	5.54	7.27	1.73	48.14
2017	5.93	8.25	2.31	46.89
2018	5.86	7.24	1.38	30.65
2019	6.02	7.09	1.07	26.44
2020	6.35	7.67	1.32	30.31
2021	6.41	8.40	1.98	35.09
2022	6.62	8.52	1.90	32.62
2023	6.75	8.68	1.93	33.94
2024	6.63	9.51	2.88	37.72
2025	6.79	8.82	2.04	38.07
Average			1.64	36.45

# Monitoring Program and Rehabilitation Projects

---

## **INTRODUCTION**

The District places an emphasis on good design and inspection to minimize I/I into the system. However, as pipes age, a variety of methods for the monitoring and identification of I/I are necessary to use. This includes yearly review of pump station records, treatment plant flow reports, trunk line flow monitoring, visual inspection of manholes and closed-circuit television (CCTV) camera inspection. Through these efforts, the District is able to locate areas of concern for follow-up investigation and correction.

## **CROSS-CONNECTIONS**

For issues on private property (i.e., stormwater cross connections, roof drains or broken laterals), the District contacts the homeowner and works with them to correct the situation. The District typically addresses issues that are within public right-of-way. All side sewer connections (between right-of-way and building envelope) are permitted and inspected by the District.

## **NEW CONSTRUCTION**

The District addresses I/I by inspecting all new systems during construction, including all mainlines, manholes and individual laterals. In addition, during plan review and field inspection, the District reviews the need for inflow dishes or watertight locking lids to control inflow. The District addresses infiltration by requiring manhole joints to be externally sealed in areas of high groundwater, vacuum testing of 50% of all new manholes and air testing of all new gravity mainlines. The District also requires newly constructed systems to be plugged during active site construction to reduce inflow of stormwater or construction debris.

## **FLOW MONITORING**

The District monitors all pump stations as well as four (4) motor operated valves (MOV's). Daily and annual review of the pump run times and flow data help to identify the potential for I/I. In addition, the two satellite service areas (Meadow Glade and Hockinson) that are served by STEP systems have individual flow meters at their termination. The District also monitored flow at six strategic locations in the service area in 2022 and 2023 in anticipation of recalibrating the hydraulic model in support of a General Sewer Plan update in 2025 & 2026.

## **REHABILITATION**

The District inspects all gravity mains and trunk sewers with CCTV cameras a minimum of every six years (recently changed from 8 years) to assess condition, I/I and other related issues. Over 90% of the District gravity system is considered in good condition. The District also performs regular inspections of nearly 80 pump stations. Results help inform the District's Capital Program, which includes a "Repair" program component. Over \$2 million is budgeted for this program on an annual basis. These programs provide for



completion of specific projects targeting the reduction of I/I in the system as well as overall system performance. Typical annual projects include:

- Sewer mainline and lateral lining projects – CCTV inspections reveal pipe defects such as cracks, holes, and root intrusion, which create avenues for I&I. Lining projects are typically advertised for bidding and completed by experienced contractors, although District Maintenance Crews have started self-performing some lateral linings. Larger lining projects are generally planned at least once every two years.
- Spot repair projects – CCTV inspections of pipes as well as routine maintenance inspections on pump stations, can reveal pipe and/or structure connection deficiencies that result in I&I. Depending on the project scope, these projects are advertised for bids or completed by District crews. 16 mainline and 25 lateral repairs were completed in 2025 by District crews.
- Pump Station Upgrades – Condition assessments and regular inspections identify the need for Pump Station repairs and upgrades. Three pump stations were upgraded in 2025, in addition to 11 pump rebuilds and 10 pump replacements.



## APPENDIX A

### ANNUAL INFILTRATION/INFLOW (I/I) REPORT





# Salmon Creek Wastewater Treatment Plant

## ANNUAL INFILTRATION/INFLOW (I/I) REPORT

**Reporting Year:                      From: 2023                      To: 2025**

Max month design flow:                      13.54 MGD (District allocation per Phase 5B Engineering Report- April 2021)  
 Peak daily design flow:                      18.10 MGD (District allocation per Phase 5B Engineering Report- April 2021)  
 Design Population Equivalent:                      140,978 Updated via above data and 2017 General Sewer Plan information

Month	Average Monthly Flow (MGD) Year			Total Monthly Rainfall (inches) Year			Population Served <i>See Comments below</i> Year			Additional Sewer Lines Added (feet) Year			
	2023	2024	2025	2023	2024	2025	2023	2024	2025*	2023	2024	2025	
January	7.84	9.51	7.79	3.91	8.72	2.36	110450	113712	128284	5700	1670	329	
February	7.57	7.79	7.95	2.35	3.64	3.62	110684	113942	128462	13931	0	8592	
March	8.12	8.22	8.37	4.43	2.84	2.98	110874	114192	128632	4630	0	0	
April	8.68	7.31	7.90	4.55	1.44	3.90	110966	114476	128880	677	20120	767	
May	7.40	7.56	7.21	0.69	2.54	3.85	111177	114743	129006	11456	3523	4483	
June	7.03	7.08	7.19	0.51	0.89	1.25	111370	114934	129159	6976	7404	125	
July	6.82	6.64	7.07	0.00	0.19	0.00	111674	115024	129444	0	1547	4105	
August	6.75	6.77	6.96	0.68	0.21	0.31	112196	115142	129549	5875	3722	0	
September	6.82	6.63	6.79	1.72	0.51	0.84	112432	115300	129838	6254	7303	20647	
October	6.98	6.66	6.94	2.14	3.33	4.47	112552	115557	130632	7344	3668	4837	
November	7.27	8.11	7.62	5.16	7.34	3.94	100329	116121	130759	11171	2603	14275	
December	8.47	7.81	8.82	7.80	6.07	10.55	100804	116937	131213	2239	5706	1850	
<b>TOTAL</b>	<b>89.73</b>	<b>90.08</b>	<b>90.62</b>	<b>33.94</b>	<b>37.72</b>	<b>38.07</b>				<b>Total (feet)</b>	<b>76253</b>	<b>57266</b>	<b>60010</b>
<b>Low</b>	<b>6.75</b>	<b>6.63</b>	<b>6.79</b>							<b>Total (miles)</b>	<b>14.44</b>	<b>10.85</b>	<b>11.37</b>
<b>High</b>	<b>8.68</b>	<b>9.51</b>	<b>8.82</b>										
<b>Average</b>	<b>7.48</b>	<b>7.51</b>	<b>7.55</b>										
<b>I/I</b>	<b>1.93</b>	<b>2.88</b>	<b>2.04</b>										

Base Year: 2003    Base Year I/I: 1.1                      MGD

### INFILTRATION/INFLOW SUMMARY

Year	I/I	% increase from base I/I	Max Month Design Flow	% of max mo. design flow
2023	1.93	75	11.48	17%
2024	2.88	162	11.48	25%
2025	2.04	85	13.54	15%

**Comments:**

\*See notes in text of the report regarding a change to 2.66 people/ERU from 2.43 people/ERU. This affects the population numbers in 2025. Prior years population is based on 2.43 people/ERU since that was shown in prior reports.  
 SCTP Phase 5 Expansion completed in 2025. Design data updated accordingly.







## APPENDIX B

### FLOW ANALYSIS DATA



## Salmon Creek Wastewater Management System - Clark Regional Wastewater District

### ANNUAL INFILTRATION/INFLOW REPORT 1/1/2025 to 12/31/2025

#### FLOW AND PRECIPITATION DATA

MONTH	Average Monthly Flow (MGD)						Total Monthly Precipitation (Inches)				
	Year						Year				
	2020	2021	2022	2023	2024	2025	2020	2022	2023	2024	2025
January	7.65	8.30	8.11	7.84	9.51	7.79	7.10	4.30	3.91	8.72	2.36
February	7.67	8.40	7.27	7.57	7.79	7.95	1.66	3.22	2.35	3.64	3.62
March	6.62	7.25	7.78	8.12	8.22	8.37	2.30	2.27	4.43	2.84	2.98
April	6.71	6.80	7.89	8.68	7.31	7.90	0.60	4.87	4.55	1.44	3.90
May	6.72	6.65	7.78	7.40	7.56	7.21	1.87	3.74	0.69	2.54	3.85
June	6.89	6.74	7.84	7.03	7.08	7.19	2.63	2.07	0.51	0.89	1.25
July	6.37	6.43	6.84	6.82	6.64	7.07	0.04	0.18	0.00	0.19	0.00
August	6.35	6.41	6.66	6.75	6.77	6.96	0.31	0.00	0.68	0.21	0.31
September	6.42	6.74	6.62	6.82	6.63	6.79	1.27	0.45	1.72	0.51	0.84
October	6.38	6.89	6.77	6.98	6.66	6.94	1.52	1.04	2.14	3.33	4.47
November	7.19	7.93	7.33	7.27	8.11	7.62	5.63	4.54	5.16	7.34	3.94
December	7.35	8.25	8.52	8.47	7.81	8.82	5.38	5.94	7.80	6.07	10.55
<b>Avg Flow / Total Rain</b>	<b>6.86</b>	<b>7.23</b>	<b>7.45</b>	<b>7.48</b>	<b>7.51</b>	<b>7.55</b>	<b>30.31</b>	<b>32.62</b>	<b>33.94</b>	<b>37.72</b>	<b>38.07</b>
Low Month	6.35	6.41	6.62	6.75	6.63	6.79	0.04	0.00	0.00	0.19	0.00
High Month	7.67	8.40	8.52	8.68	9.51	8.82	7.10	5.94	7.80	8.72	10.55

#### POPULATION AND SEWER LINE DATA

MONTH	Population Served (Population Equivalent)	Sewer Lines Added (Feet)
	Year	Year
	2025	2025
January	128284	329
February	128462	8592
March	128632	0
April	128880	767
May	129006	4483
June	129159	125
July	129444	4105
August	129549	0
September	129838	20647
October	130632	4837
November	130759	14275
December	131213	1850
<b>Present Equivalent</b>	<b>131213</b>	<b>Total (feet) 60010</b>
		<b>Total (miles) 11.37</b>

**Comments:** Measured data presented in this report reflects the Clark Regional Wastewater District's capacity usage only.

Battle Ground usage is reported separately.

Beginning Balance of Population Served was 128,005 (based on 2.66 people/ERU - see next comment)

See notes in report regarding a change to 2.66 people/ERU from 2.43 people/ERU. This affects the population numbers in 2025 compared to prior years.



# Salmon Creek Wastewater Management System - Clark Regional Wastewater District

## ANNUAL INFILTRATION/INFLOW REPORT

1/1/2025

to

12/31/2025

### DETERMINATION OF NON EXCESSIVE INFILTRATION    DETERMINATION OF NON EXCESSIVE INFLOW

**EPA Infiltration Criteria                      120 gpcd**

**District Infiltration                              69 gpcd**

**EPA Inflow Criteria                              275 gpcd**

**District Inflow                                      131 gpcd**

Period	Flow	Rain	Population Equivalent
Jan 23	8.82	0.00	128284
Jan 24	8.74	0.00	128284
Jan 25	8.98	0.00	128284
Jan 26	9.12	0.00	128284
Jan 27	8.91	0.00	128284
Jan 28	8.60	0.00	128284
Jan 29	8.52	0.00	128284
<b>Average Flow (MGD)</b>	<b>8.81</b>	<b>0.00</b>	<b>Inches Rain</b>

**Comments:** The seven day period of January 23 through January 29, 2025 is identified as a dry weather period within a period of seasonal high groundwater. Note that dry weather occurred several days before this period. January was relatively dry compared to normal.

Period	Flow	Rain	Population Equivalent
Dec 04	10.02	0.69	131213
Dec 05	13.41	0.67	131213
Dec 06	12.44	0.05	131213
Dec 07	12.05	0.57	131213
Dec 08	12.93	1.77	131213
Dec 09	17.15	1.89	131213
Dec 10	14.56	0.88	131213
<b>Highest Average Flow (MGD)</b>	<b>17.15</b>	<b>6.52</b>	<b>Inches Rain</b>

**Comments:** The seven day period of December 4 through December 10, 2025 was identified as a period of significant rainfall with surface ponding and runoff. December 9 was the highest recorded daily flow during a storm event.

B-2

# Salmon Creek Wastewater Management System - Clark Regional Wastewater District

## ANNUAL INFILTRATION/INFLOW REPORT

1/1/2025

to

12/31/2025

### INFILTRATION/INFLOW SUMMARY

Year	I/I	% Over Base I/I	Max Mo. Design Flow	% of Max Design Flow
2020	1.32	20%	11.48	11%
2021	1.98	80%	11.48	17%
2022	1.90	73%	11.48	17%
2023	1.93	75%	11.48	17%
2024	2.88	162%	11.48	25%
2025	2.04	85%	13.54	15%

Base Year: 2003

I/I: 1.1


### 2025 PLANT DESIGN CAPACITY (District Only)

Per Phase 5B Engineering Report

Max Month Design Flow:	13.54 MGD
Peak Daily Design Flow:	18.10 MGD
Design Population Equivalent:	140,978 People

**Comments:** -See Overview & Analysis for I/I discussion  
 -2020-2024 % of Max Design Flow based on Pre-2025 Plant Design Capacity

### 2025 Average Flow and Precipitation

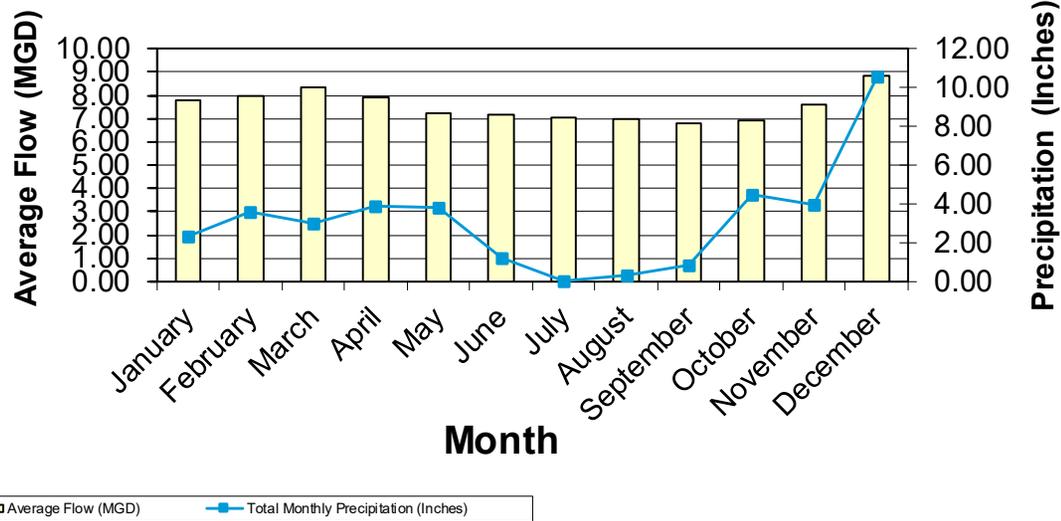

**Comments:** Design capacity represents District only plant capacity. Present population and infiltration/inflow data included in this report represent Clark Regional Wastewater's usage only. Battle Ground capacity and usage is reported separately.





## APPENDIX C

### MONTHLY FLOW AND RAINFALL



## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
1/1/2025	32800	251000	2.82	2.53	10.73	0.06	0.14	8.20
1/2/2025	48000	285200	3.18	2.85	11.24	0.68	0.46	8.39
1/3/2025	61200	300400	3.64	3.28	12.48	0.66	0.35	9.20
1/4/2025	58000	280200	3.55	3.21	12.79	0.67	0.29	9.58
1/5/2025	49000	273500	3.58	3.26	12.97	0.11	0.06	9.71
1/6/2025	49900	236300	3.01	2.72	11.81	0.00	0.00	9.09
1/7/2025	42700	222400	2.80	2.54	10.91	0.01	0.01	8.37
1/8/2025	40000	209800	2.52	2.27	10.34	0.00	0.01	8.07
1/9/2025	41900	215100	2.51	2.25	10.05	0.08	0.00	7.80
1/10/2025	42500	209200	2.42	2.17	10.08	0.29	0.23	7.91
1/11/2025	35900	236100	2.78	2.51	10.33	0.32	0.06	7.82
1/12/2025	34200	241000	2.75	2.48	10.71	0.06	0.00	8.23
1/13/2025	42200	219700	2.58	2.32	10.10	0.01	0.00	7.78
1/14/2025	40900	223700	2.51	2.25	9.73	0.00	0.00	7.48
1/15/2025	37300	201500	2.20	1.97	9.59	0.00	0.00	7.62
1/16/2025	36900	209800	2.26	2.01	9.43	0.02	0.00	7.42
1/17/2025	34400	210300	2.10	1.85	9.20	0.00	0.00	7.35
1/18/2025	26100	213300	2.08	1.84	9.31	0.00	0.00	7.47
1/19/2025	21700	220500	2.08	1.84	9.29	0.00	0.00	7.45
1/20/2025	24000	242800	2.21	1.94	9.24	0.00	0.00	7.30
1/21/2025	32500	212800	1.99	1.75	8.99	0.00	0.00	7.24
1/22/2025	30900	218500	1.97	1.72	8.83	0.00	0.00	7.11
1/23/2025	31000	205700	1.93	1.69	8.82	0.00	0.00	7.13
1/24/2025	26100	202500	1.83	1.60	8.74	0.00	0.00	7.14
1/25/2025	24800	208100	1.95	1.72	8.98	0.00	0.00	7.26
1/26/2025	21600	225700	2.03	1.78	9.12	0.00	0.00	7.34
1/27/2025	29200	222100	1.89	1.64	8.91	0.00	0.00	7.27
1/28/2025	29000	194200	1.76	1.54	8.60	0.00	0.00	7.06
1/29/2025	27200	210400	1.81	1.57	8.52	0.00	0.00	6.95
1/30/2025	29900	217400	1.91	1.67	8.43	0.50	0.02	6.76
1/31/2025	45600	270100	2.53	2.22	9.55	0.45	0.73	7.33
<b>Total</b>	1127400	7089300	75.18	66.96	307.82	3.92	2.36	240.86
<b>Min**</b>	21600	194200	1.76	1.54	8.43	0.00	0.00	6.76
<b>Max</b>	61200	300400	3.64	3.28	12.97	0.68	0.73	9.71
<b>Average</b>	36368	228687	2.43	2.16	9.93	0.13	0.08	7.77

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
2/1/2025	26200	244000	2.27	2.00	9.75	0.06	0.01	7.75
2/2/2025	28000	233800	2.16	1.90	9.83	0.05	0.01	7.93
2/3/2025	32500	238600	2.13	1.86	9.41	0.02	0.01	7.55
2/4/2025	34200	222200	2.06	1.80	9.05	0.01	0.00	7.25
2/5/2025	35300	243200	2.13	1.85	9.09	0.17	0.10	7.24
2/6/2025	33800	231000	2.03	1.77	9.03	0.01	0.00	7.26
2/7/2025	34700	213800	2.00	1.75	8.80	0.21	0.02	7.05
2/8/2025	28100	224300	2.08	1.83	9.31	0.05	0.10	7.48
2/9/2025	25600	240500	2.11	1.85	9.41	0.00	0.00	7.56
2/10/2025	33800	238700	2.10	1.83	9.07	0.00	0.00	7.24
2/11/2025	35700	227200	1.97	1.71	8.87	0.00	0.00	7.16
2/12/2025	32400	219900	1.96	1.71	8.78	0.00	0.00	7.07
2/13/2025	19400	202200	1.86	1.64	8.74	0.32	0.01	7.10
2/14/2025	21600	210100	1.93	1.70	8.95	0.03	0.30	7.25
2/15/2025	25200	225800	2.16	1.91	9.34	0.21	0.32	7.43
2/16/2025	34700	261900	2.48	2.19	10.26	0.61	0.26	8.07
2/17/2025	53200	319500	3.30	2.93	11.29	0.29	0.13	8.36
2/18/2025	47700	293500	2.85	2.51	10.64	0.23	0.01	8.13
2/19/2025	45700	283100	2.79	2.46	10.59	0.11	0.23	8.13
2/20/2025	41400	258200	2.60	2.30	10.12	0.00	0.00	7.82
2/21/2025	41900	0	2.44	2.40	9.78	0.11	0.05	7.38
2/22/2025	56700	0	3.48	3.43	10.27	1.25	0.71	6.84
2/23/2025	69600	0	4.06	3.99	14.03	0.60	0.55	10.04
2/24/2025	81600	1303400	4.25	2.87	13.75	0.90	0.71	10.88
2/25/2025	56700	256100	3.53	3.22	13.43	0.11	0.08	10.21
2/26/2025	46900	232200	3.13	2.85	11.93	0.04	0.01	9.08
2/27/2025	47400	217200	2.89	2.62	10.99	0.00	0.00	8.37
2/28/2025	39500	187800	2.54	2.32	10.41	0.00	0.00	8.09
<b>Total</b>	1109500	7028200	71.31	63.17	284.92	5.39	3.62	221.75
<b>Min</b>	19400	0	1.86	1.64	8.74	0.00	0.00	6.84
<b>Max</b>	81600	1303400	4.25	3.99	14.03	1.25	0.71	10.88
<b>Average</b>	39625	251007	2.55	2.26	10.18	0.19	0.13	7.92

2/13/25 - 2" Snow BG

2/21-2/23/25 - Meadow Glade non-reads due to lock placed on flow meter cabinet by Clark Regional Wastewater District

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
3/1/2025	27600	201100	2.52	2.29	10.33	0.01	0.27	8.04
3/2/2025	27500	209000	2.52	2.28	10.32	0.04	0.19	8.04
3/3/2025	36000	194700	2.29	2.05	9.77	0.02	0.15	7.72
3/4/2025	38500	201800	2.28	2.04	9.51	0.16	0.08	7.47
3/5/2025	37300	204100	2.17	1.93	9.46	0.01	0.01	7.53
3/6/2025	35900	205800	2.15	1.91	9.31	0.01	0.00	7.40
3/7/2025	34700	196200	1.99	1.76	9.05	0.00	0.00	7.29
3/8/2025	22900	215800	1.96	1.72	9.17	0.00	0.00	7.45
3/9/2025	25900	235800	2.16	1.90	9.55	0.37	0.09	7.65
3/10/2025	42200	249100	2.25	1.96	9.33	0.00	0.34	7.37
3/11/2025	36700	233200	2.13	1.86	9.25	0.15	0.28	7.39
3/12/2025	51100	281700	2.66	2.33	9.72	1.10	0.03	7.39
3/13/2025	55000	344900	3.43	3.03	12.20	0.21	0.00	9.17
3/14/2025	49600	300400	2.91	2.56	11.46	0.29	0.00	8.90
3/15/2025	47700	341200	3.36	2.97	11.97	0.75	0.00	9.00
3/16/2025	42300	305700	3.43	3.08	13.02	0.01	0.00	9.94
3/17/2025	41600	234800	2.76	2.48	11.67	0.07	0.00	9.19
3/18/2025	42600	213800	2.57	2.31	10.73	0.01	0.00	8.42
3/19/2025	40800	220500	2.54	2.28	10.43	0.25	0.00	8.15
3/20/2025	44100	227900	2.69	2.42	10.68	0.36	0.02	8.26
3/21/2025	69500	306400	3.74	3.36	12.35	0.83	0.00	8.99
3/22/2025	40300	246800	3.17	2.88	13.13	0.27	0.00	10.25
3/23/2025	46100	268100	3.23	2.92	12.35	0.10	0.25	9.43
3/24/2025	51900	230300	2.89	2.61	11.73	0.03	0.08	9.12
3/25/2025	43300	214600	2.60	2.34	10.90	0.00	0.14	8.56
3/26/2025	46400	244100	2.77	2.48	10.76	0.33	0.24	8.28
3/27/2025	45100	234700	2.69	2.41	10.85	0.35	0.51	8.44
3/28/2025	48000	216200	2.64	2.38	11.11	0.35	0.16	8.73
3/29/2025	43400	235500	2.91	2.63	11.23	0.03	0.00	8.60
3/30/2025	36100	228900	2.78	2.52	11.05	0.24	0.00	8.53
3/31/2025	41300	223900	2.70	2.43	10.91	0.13	0.00	8.48
<b>Total</b>	1291400	7467000	82.87	74.11	333.30	6.48	2.84	259.19
<b>Min</b>	22900	194700	1.96	1.72	9.05	0.00	0.00	7.29
<b>Max</b>	69500	344900	3.74	3.36	13.13	1.10	0.51	10.25
<b>Average</b>	41658	240871	2.67	2.39	10.75	0.21	0.09	8.36

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
4/1/2025	34600	208600	2.48	2.24	10.45	0.02	0.00	8.21
4/2/2025	31500	209300	2.39	2.15	10.13	0.09	0.13	7.98
4/3/2025	28800	206200	2.36	2.13	9.79	0.00	0.00	7.66
4/4/2025	31500	213100	2.27	2.03	9.75	0.00	0.00	7.72
4/5/2025	25500	217900	2.15	1.91	9.82	0.03	0.00	7.91
4/6/2025	32800	254300	2.47	2.19	10.63	0.64	0.03	8.44
4/7/2025	49700	291300	2.80	2.46	11.58	0.20	0.05	9.12
4/8/2025	46200	266600	2.71	2.40	10.98	0.16	0.01	8.58
4/9/2025	42100	250500	2.47	2.18	10.56	0.00	0.01	8.38
4/10/2025	44800	230200	2.38	2.10	10.35	0.14	0.01	8.25
4/11/2025	40100	224000	2.27	2.01	10.12	0.00	0.00	8.11
4/12/2025	28200	221000	2.25	2.00	10.13	0.00	0.00	8.13
4/13/2025	26900	233800	2.28	2.02	10.28	0.00	0.00	8.26
4/14/2025	35100	206000	2.08	1.84	9.90	0.00	0.00	8.06
4/15/2025	33700	203000	2.03	1.79	9.67	0.00	0.00	7.88
4/16/2025	35400	215700	2.02	1.77	9.47	0.00	0.00	7.70
4/17/2025	34600	214200	2.01	1.76	9.40	0.03	0.00	7.64
4/18/2025	33800	204700	1.97	1.74	9.27	0.00	0.00	7.53
4/19/2025	22200	209400	1.92	1.69	9.45	0.00	0.06	7.76
4/20/2025	19700	194800	1.81	1.60	9.52	0.09	0.00	7.92
4/21/2025	32000	220200	1.97	1.72	9.40	0.00	1.92	7.68
4/22/2025	29600	194200	1.60	1.38	9.14	0.00	0.00	7.76
4/23/2025	32600	201500	1.79	1.56	9.11	0.00	0.16	7.55
4/24/2025	30100	200700	1.81	1.58	9.05	0.00	0.19	7.47
4/25/2025	29200	187700	1.69	1.48	8.94	0.00	0.53	7.46
4/26/2025	18000	198300	1.74	1.53	9.04	0.00	0.46	7.52
4/27/2025	17900	207600	1.79	1.56	9.35	0.00	0.03	7.79
4/28/2025	29900	214500	1.82	1.57	9.09	0.20	0.00	7.52
4/29/2025	33600	192500	1.74	1.52	9.03	0.02	0.31	7.51
4/30/2025	29500	202800	1.72	1.49	8.91	0.00	0.00	7.42
<b>Total</b>	959600	6494600	62.82	55.37	292.31	1.62	3.90	236.94
<b>Min</b>	17900	187700	1.60	1.38	8.91	0.00	0.00	7.42
<b>Max</b>	49700	291300	2.80	2.46	11.58	0.64	1.92	9.12
<b>Average</b>	31987	216487	2.09	1.85	9.74	0.05	0.13	7.90

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
5/1/2025	30600	183500	1.72	1.50	8.92	0.00	0.00	7.42
5/2/2025	30800	180300	1.64	1.43	8.89	0.02	0.00	7.46
5/3/2025	20200	185400	1.69	1.48	8.93	0.00	0.00	7.45
5/4/2025	20100	214300	1.73	1.49	9.28	0.00	0.00	7.79
5/5/2025	30200	192300	1.71	1.49	8.99	0.00	0.00	7.50
5/6/2025	29100	185600	1.61	1.39	8.79	0.00	0.00	7.40
5/7/2025	32500	181600	1.57	1.36	8.73	0.00	0.00	7.37
5/8/2025	29700	189100	1.69	1.47	8.68	0.00	0.00	7.21
5/9/2025	29700	185500	1.59	1.38	8.61	0.00	0.00	7.23
5/10/2025	17800	187100	1.62	1.41	8.75	0.07	0.00	7.34
5/11/2025	16300	181100	1.60	1.40	9.00	0.12	1.71	7.60
5/12/2025	32800	203900	1.73	1.50	9.04	0.20	1.52	7.54
5/13/2025	29500	190700	1.64	1.42	8.78	0.02	0.00	7.36
5/14/2025	29300	195700	1.64	1.41	8.72	0.01	0.07	7.31
5/15/2025	28200	188700	1.62	1.40	8.34	0.10	0.02	6.94
5/16/2025	30800	179800	1.63	1.42	8.18	0.62	0.15	6.76
5/17/2025	27200	191700	1.85	1.63	9.12	0.05	0.04	7.49
5/18/2025	25500	197600	1.86	1.64	9.01	0.21	0.02	7.37
5/19/2025	36400	196900	1.95	1.72	8.91	0.25	0.01	7.19
5/20/2025	33100	189700	1.88	1.66	8.67	0.20	0.01	7.01
5/21/2025	31200	192900	1.83	1.60	8.59	0.00	0.00	6.99
5/22/2025	28900	187400	1.75	1.53	8.50	M*	0.00	6.97
5/23/2025	30500	173800	1.67	1.47	8.38	0.00	0.00	6.91
5/24/2025	18900	182200	1.71	1.51	8.34	0.00	0.00	6.83
5/25/2025	17700	173100	1.56	1.37	8.20	0.00	0.00	6.83
5/26/2025	18200	200700	1.79	1.57	8.86	0.00	0.00	7.29
5/27/2025	27400	189700	1.70	1.48	8.52	0.00	0.00	7.04
5/28/2025	28200	187100	1.61	1.40	8.29	0.01	0.00	6.89
5/29/2025	28400	184500	1.65	1.43	8.28	0.16	0.07	6.85
5/30/2025	28300	180200	1.63	1.42	8.25	0.00	0.06	6.83
5/31/2025	24600	190400	1.67	1.45	8.43	0.00	0.17	6.98
<b>Total</b>	842100	5842500	52.53	45.84	268.98	2.04	3.85	223.14
<b>Min</b>	16300	173100	1.56	1.36	8.18	0.00	0.00	6.76
<b>Max</b>	36400	214300	1.95	1.72	9.28	0.62	1.71	7.79
<b>Average</b>	27165	188468	1.69	1.48	8.68	0.07	0.12	7.20

M\* 5/22/25 - Weather Station Malfunctioned

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
6/1/2025	18200	182900	1.63	1.43	8.64	0.00	0.00	7.21
6/2/2025	26900	190200	1.63	1.41	8.47	0.12	0.00	7.16
6/3/2025	27600	193000	1.62	1.40	8.29	0.10	0.02	7.21
6/4/2025	27700	192600	1.58	1.36	8.18	0.01	0.01	7.19
6/5/2025	29800	177700	1.60	1.40	8.23	0.00	0.00	7.26
6/6/2025	27500	184200	1.52	1.31	8.27	0.05	0.00	7.35
6/7/2025	15900	189300	1.57	1.36	8.26	0.13	0.00	7.19
6/8/2025	18300	207300	1.69	1.46	8.53	0.05	0.00	7.13
6/9/2025	26800	172400	1.55	1.35	8.61	0.00	0.00	7.11
6/10/2025	26900	184800	1.55	1.34	8.60	0.00	0.00	7.19
6/11/2025	25300	177900	1.51	1.31	8.55	0.00	0.00	7.53
6/12/2025	22600	186000	1.56	1.35	8.51	0.00	0.00	7.16
6/13/2025	18400	179700	1.49	1.29	8.50	0.00	0.00	7.21
6/14/2025	16700	180200	1.54	1.34	8.53	0.00	0.00	7.19
6/15/2025	17100	185700	1.58	1.38	8.64	0.00	0.00	7.26
6/16/2025	18200	190900	1.58	1.37	8.72	0.00	0.00	7.35
6/17/2025	16700	186200	1.50	1.29	8.48	0.00	0.00	7.19
6/18/2025	18900	176600	1.44	1.24	8.37	0.00	0.00	7.13
6/19/2025	17100	188200	1.57	1.36	8.47	0.00	0.00	7.11
6/20/2025	19800	177700	1.58	1.39	8.58	0.37	0.62	7.19
6/21/2025	22800	183100	1.76	1.56	9.09	0.42	0.40	7.53
6/22/2025	18000	197300	1.76	1.55	9.02	0.00	0.00	7.47
6/23/2025	17900	179000	1.64	1.45	8.90	0.00	0.00	7.45
6/24/2025	16100	179000	1.55	1.35	8.66	0.00	0.00	7.31
6/25/2025	17100	188700	1.58	1.37	8.44	0.00	0.00	7.07
6/26/2025	16800	188700	1.59	1.38	8.52	0.00	0.00	7.14
6/27/2025	19900	207600	1.64	1.41	8.46	0.00	0.00	7.05
6/28/2025	17100	186300	1.52	1.32	8.48	0.00	0.00	7.16
6/29/2025	15100	186500	1.53	1.33	8.69	0.00	0.00	7.36
6/30/2025	16100	190800	1.60	1.39	8.67	0.00	0.00	7.28
<b>Total</b>	613300	5590500	47.45	41.24	256.36	1.25	1.05	217.15
<b>Min</b>	15100	172400	1.44	1.24	8.18	0.00	0.00	7.05
<b>Max</b>	29800	207600	1.76	1.56	9.09	0.42	0.62	7.53
<b>Average</b>	20443	186350	1.58	1.37	8.55	0.04	0.04	7.24

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
7/1/2025	19300	189400	1.57	1.36	8.55	0.00	0.00	7.19
7/2/2025	17500	190600	1.55	1.34	8.43	0.00	0.00	7.09
7/3/2025	17400	168800	1.46	1.27	8.43	0.00	0.00	7.16
7/4/2025	16200	195600	1.48	1.27	8.18	0.00	0.00	6.91
7/5/2025	14700	186800	1.50	1.30	8.15	0.00	0.00	6.85
7/6/2025	17900	196500	1.60	1.39	8.60	0.00	0.00	7.21
7/7/2025	16900	201100	1.59	1.37	8.58	0.00	0.00	7.21
7/8/2025	17600	196300	1.53	1.32	8.36	0.00	0.00	7.04
7/9/2025	18300	185500	1.50	1.30	8.39	0.00	0.00	7.09
7/10/2025	19100	198800	1.54	1.32	8.30	0.00	0.00	6.98
7/11/2025	17800	169400	1.38	1.19	8.29	0.00	0.00	7.10
7/12/2025	18500	200500	1.54	1.32	8.28	0.00	0.00	6.96
7/13/2025	16400	196400	1.53	1.32	8.45	0.00	0.00	7.13
7/14/2025	17200	187800	1.51	1.31	8.49	0.00	0.00	7.18
7/15/2025	16900	189700	1.46	1.25	8.25	0.00	0.00	7.00
7/16/2025	18500	188900	1.46	1.25	8.22	0.00	0.00	6.97
7/17/2025	16900	181400	1.48	1.28	8.31	0.00	0.00	7.03
7/18/2025	16400	179300	1.49	1.29	8.27	0.00	0.00	6.98
7/19/2025	17000	184700	1.47	1.26	8.21	0.00	0.00	6.95
7/20/2025	18400	196400	1.56	1.35	8.43	0.00	0.00	7.08
7/21/2025	18600	187400	1.53	1.32	8.43	0.00	0.00	7.11
7/22/2025	18200	180500	1.45	1.25	7.83	0.00	0.00	6.58
7/23/2025	20600	191100	1.48	1.27	8.02	0.00	0.00	6.75
7/24/2025	17400	177700	1.49	1.30	8.22	0.00	0.00	6.92
7/25/2025	17100	184700	1.46	1.26	8.86	0.00	0.00	7.60
7/26/2025	15900	193700	1.45	1.24	8.16	0.00	0.00	6.92
7/27/2025	17300	210400	1.56	1.33	8.41	0.00	0.00	7.08
7/28/2025	15400	194800	1.49	1.28	8.45	0.00	0.00	7.17
7/29/2025	17200	201400	1.46	1.24	8.22	0.00	0.00	6.98
7/30/2025	15600	184500	1.43	1.23	8.18	0.00	0.00	6.95
7/31/2025	18100	192700	1.56	1.35	8.23	0.00	0.00	6.88
<b>Total</b>	540300	5882800	46.54	40.12	258.18	0.00	0.00	218.06
<b>Min</b>	14700	168800	1.38	1.19	7.83	0.00	0.00	6.58
<b>Max</b>	20600	210400	1.60	1.39	8.86	0.00	0.00	7.60
<b>Average</b>	17429	189768	1.50	1.29	8.33	0.00	0.00	7.03

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
8/1/2025	14500	185900	1.45	1.25	8.18	0.00	0.00	6.93
8/2/2025	13800	188100	1.55	1.35	8.26	0.00	0.00	6.91
8/3/2025	15000	197600	1.57	1.36	8.59	0.00	0.00	7.23
8/4/2025	16900	190300	1.53	1.33	8.43	0.00	0.00	7.10
8/5/2025	15300	179300	1.49	1.29	8.24	0.13	0.00	6.95
8/6/2025	16400	192700	1.53	1.32	8.30	0.44	0.19	6.98
8/7/2025	13900	187100	1.52	1.32	8.37	0.00	0.00	7.05
8/8/2025	15800	185900	1.53	1.33	8.32	0.00	0.00	6.99
8/9/2025	14300	186700	1.46	1.26	8.27	0.00	0.00	7.01
8/10/2025	14400	191400	1.51	1.30	8.43	0.00	0.00	7.13
8/11/2025	14200	188400	1.55	1.35	8.37	0.00	0.00	7.02
8/12/2025	19300	178000	1.45	1.25	8.26	0.00	0.00	7.01
8/13/2025	13900	187100	1.47	1.27	8.28	0.00	0.00	7.01
8/14/2025	13400	189800	1.50	1.30	8.21	0.03	0.00	6.91
8/15/2025	15700	185900	1.52	1.31	8.12	0.05	0.06	6.81
8/16/2025	14100	190000	1.56	1.35	8.50	0.01	0.06	7.15
8/17/2025	15200	197100	1.59	1.38	8.60	0.00	0.00	7.22
8/18/2025	15700	178200	1.52	1.32	8.46	0.00	0.00	7.14
8/19/2025	16900	195800	1.49	1.28	8.28	0.00	0.00	7.00
8/20/2025	15800	180400	1.49	1.29	8.19	0.00	0.00	6.90
8/21/2025	17200	183600	1.49	1.29	7.97	0.00	0.00	6.68
8/22/2025	17300	189100	1.52	1.32	7.85	0.00	0.00	6.53
8/23/2025	16000	188900	1.48	1.28	7.89	0.00	0.00	6.61
8/24/2025	16300	191500	1.55	1.35	8.29	0.00	0.00	6.94
8/25/2025	21000	200500	1.58	1.36	8.30	0.00	0.00	6.94
8/26/2025	22400	193900	1.52	1.30	8.18	0.05	0.00	6.88
8/27/2025	22000	184300	1.47	1.26	8.00	0.00	0.00	6.74
8/28/2025	24400	180300	1.50	1.30	8.02	0.00	0.00	6.72
8/29/2025	27500	187400	1.47	1.25	7.91	0.00	0.00	6.66
8/30/2025	17600	220100	1.62	1.38	7.87	0.00	0.00	6.49
8/31/2025	13500	151300	1.22	1.06	7.78	0.00	0.00	6.72
<b>Total</b>	519700	5826600	46.70	40.35	254.72	0.71	0.31	214.37
<b>Min</b>	13400	151300	1.22	1.06	7.78	0.00	0.00	6.49
<b>Max</b>	27500	220100	1.62	1.38	8.60	0.44	0.19	7.23
<b>Average</b>	16765	187955	1.51	1.30	8.22	0.02	0.01	6.92

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
9/1/2025	17300	216200	1.70	1.46	8.48	0.00	0.00	7.02
9/2/2025	28300	183800	1.47	1.26	8.25	0.00	0.00	6.99
9/3/2025	26000	192800	1.46	1.24	8.11	0.00	0.00	6.87
9/4/2025	26400	184900	1.48	1.27	8.05	0.00	0.00	6.78
9/5/2025	28900	194800	1.58	1.36	7.92	0.01	0.01	6.56
9/6/2025	18100	181900	1.42	1.22	7.96	0.00	0.01	6.74
9/7/2025	15900	183800	1.46	1.26	8.28	0.00	0.00	7.02
9/8/2025	26300	202900	1.55	1.32	8.13	0.00	0.00	6.81
9/9/2025	29900	201500	1.54	1.31	8.08	0.00	0.00	6.77
9/10/2025	26100	188500	1.45	1.23	7.95	0.00	0.00	6.72
9/11/2025	27200	181900	1.49	1.29	8.02	0.00	0.00	6.73
9/12/2025	33500	180100	1.47	1.25	7.93	0.06	0.00	6.68
9/13/2025	18400	186500	1.47	1.27	8.00	0.12	0.00	6.73
9/14/2025	16200	189900	1.52	1.32	8.37	0.00	0.07	7.05
9/15/2025	26900	195000	1.56	1.34	8.11	0.00	0.00	6.77
9/16/2025	29900	184400	1.45	1.24	7.90	0.00	0.00	6.66
9/17/2025	26400	192500	1.49	1.27	7.82	0.00	0.00	6.55
9/18/2025	27700	186700	1.51	1.30	7.81	0.00	0.00	6.51
9/19/2025	30700	159400	1.40	1.21	7.80	0.00	0.00	6.59
9/20/2025	20500	181900	1.49	1.29	7.94	0.43	0.00	6.65
9/21/2025	18300	191500	1.58	1.37	8.46	0.02	0.37	7.09
9/22/2025	27600	186700	1.58	1.37	8.14	0.00	0.00	6.77
9/23/2025	28100	178800	1.45	1.24	7.87	0.00	0.00	6.63
9/24/2025	26500	180600	1.47	1.27	7.85	0.00	0.00	6.58
9/25/2025	29700	182400	1.46	1.25	7.85	0.00	0.00	6.60
9/26/2025	28700	176100	1.43	1.22	7.84	0.00	0.00	6.62
9/27/2025	16200	183300	1.45	1.25	7.89	0.00	0.00	6.64
9/28/2025	15600	193600	1.55	1.34	8.24	0.00	0.00	6.90
9/29/2025	25900	186500	1.51	1.29	8.03	0.17	0.26	6.74
9/30/2025	29800	185800	1.51	1.30	7.99	0.29	0.12	6.70
<b>Total</b>	747000	5614700	44.96	38.60	241.07	1.10	0.84	202.47
<b>Min</b>	15600	159400	1.40	1.21	7.80	0.00	0.00	6.51
<b>Max</b>	33500	216200	1.70	1.46	8.48	0.43	0.37	7.09
<b>Average</b>	24900	187157	1.50	1.29	8.04	0.04	0.03	6.75

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
10/1/2025	30000	191400	1.58	1.36	8.16	0.24	0.39	6.80
10/2/2025	27400	191900	1.30	1.08	8.09	0.03	0.01	7.01
10/3/2025	27900	183500	1.52	1.31	7.91	0.00	0.00	6.60
10/4/2025	21100	181400	1.51	1.30	8.01	0.00	0.00	6.71
10/5/2025	19200	197600	1.56	1.34	8.30	0.00	0.00	6.96
10/6/2025	28700	193200	1.54	1.32	8.07	0.00	0.00	6.75
10/7/2025	27100	189100	1.48	1.26	7.85	0.00	0.00	6.59
10/8/2025	27700	183100	1.47	1.26	7.78	0.00	0.00	6.52
10/9/2025	27800	177600	1.49	1.29	7.74	0.00	0.00	6.45
10/10/2025	18000	180300	1.42	1.23	7.74	0.60	0.02	6.51
10/11/2025	18200	194200	1.53	1.31	7.93	0.19	0.10	6.62
10/12/2025	20000	206800	1.74	1.51	8.52	0.67	0.51	7.01
10/13/2025	30900	197200	1.70	1.47	8.58	0.01	0.00	7.11
10/14/2025	28100	181500	1.55	1.34	7.98	0.00	0.00	6.64
10/15/2025	28300	184300	1.53	1.32	7.85	0.00	0.01	6.53
10/16/2025	27900	199400	1.59	1.36	7.89	0.00	0.01	6.53
10/17/2025	26600	180700	1.46	1.25	7.76	0.01	0.00	6.51
10/18/2025	23800	191600	1.69	1.47	8.10	1.05	0.68	6.63
10/19/2025	24400	212200	1.92	1.68	9.34	0.15	0.07	7.66
10/20/2025	28600	186500	1.73	1.51	8.48	0.01	0.02	6.97
10/21/2025	30000	184500	1.61	1.40	8.13	0.00	0.01	6.73
10/22/2025	26400	192400	1.58	1.36	7.98	0.00	0.01	6.62
10/23/2025	30400	181000	1.55	1.34	7.91	0.00	0.00	6.57
10/24/2025	38300	195100	2.15	1.91	9.11	1.49	0.90	7.20
10/25/2025	31400	206600	2.51	2.27	9.61	0.91	0.43	7.34
10/26/2025	29100	184800	2.31	2.10	10.46	0.46	0.44	8.36
10/27/2025	33600	184800	2.08	1.86	9.64	0.01	0.05	7.78
10/28/2025	36000	188600	2.10	1.87	8.88	0.51	0.22	7.01
10/29/2025	32600	189600	2.04	1.82	9.10	0.01	0.01	7.28
10/30/2025	28900	183800	1.92	1.71	8.72	0.00	0.02	7.01
10/31/2025	35500	190300	2.18	1.96	8.57	1.15	0.56	6.61
<b>Total</b>	863900	5885000	53.32	46.57	260.19	7.50	4.47	213.62
<b>Min</b>	18000	177600	1.30	1.08	7.74	0.00	0.00	6.45
<b>Max</b>	38300	212200	2.51	2.27	10.46	1.49	0.90	8.36
<b>Average</b>	27868	189839	1.72	1.50	8.39	0.24	0.14	6.89

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
11/1/2025	41000	198400	2.90	2.66	11.06	0.48	0.45	8.40
11/2/2025	32000	202200	2.48	2.24	10.07	0.01	0.00	7.83
11/3/2025	47500	213100	2.74	2.48	10.09	0.62	0.50	7.61
11/4/2025	40000	166100	2.31	2.11	9.98	0.38	0.47	7.87
11/5/2025	45100	198600	2.68	2.44	10.49	0.41	0.29	8.05
11/6/2025	58300	208000	3.20	2.93	10.75	0.88	0.38	7.82
11/7/2025	44500	186600	2.58	2.34	10.95	0.05	0.00	8.61
11/8/2025	27500	192200	2.39	2.17	9.95	0.00	0.00	7.78
11/9/2025	26500	209600	2.34	2.11	9.75	0.00	0.00	7.64
11/10/2025	36100	175500	2.00	1.79	9.18	0.01	0.00	7.39
11/11/2025	22600	199200	2.12	1.90	9.07	0.00	0.00	7.17
11/12/2025	31000	198600	1.94	1.71	8.77	0.00	0.00	7.06
11/13/2025	34700	194700	1.96	1.73	8.76	0.03	0.00	7.03
11/14/2025	30700	179500	1.89	1.68	8.65	0.20	0.00	6.97
11/15/2025	25000	192000	1.99	1.77	8.84	0.20	0.00	7.07
11/16/2025	26300	203700	2.22	1.99	9.40	0.51	0.32	7.41
11/17/2025	39800	194700	2.26	2.02	9.67	0.00	0.10	7.65
11/18/2025	37800	198600	2.09	1.85	9.07	0.00	0.00	7.22
11/19/2025	35300	198200	2.02	1.78	8.86	0.14	0.00	7.08
11/20/2025	33900	196000	2.03	1.80	8.91	0.02	0.10	7.11
11/21/2025	32100	183300	1.84	1.62	8.70	0.00	0.07	7.08
11/22/2025	26000	196500	1.90	1.67	8.81	0.04	0.00	7.14
11/23/2025	27100	217800	2.27	2.03	9.43	0.42	0.18	7.40
11/24/2025	28700	200600	2.15	1.92	9.24	0.16	0.02	7.32
11/25/2025	34100	199100	2.25	2.02	9.34	0.53	0.38	7.32
11/26/2025	52000	252500	2.96	2.66	10.52	0.62	0.26	7.86
11/27/2025	34900	260300	3.03	2.74	11.35	0.34	0.35	8.61
11/28/2025	34300	225400	2.70	2.44	10.51	0.00	0.06	8.07
11/29/2025	28700	202200	2.29	2.06	10.13	0.00	0.01	8.07
11/30/2025	26000	221900	2.31	2.06	10.01	0.00	0.00	7.95
<b>Total</b>	1039500	6065100	69.83	62.73	290.31	6.05	3.94	227.58
<b>Min</b>	22600	166100	1.84	1.62	8.65	0.00	0.00	6.97
<b>Max</b>	58300	260300	3.20	2.93	11.35	0.88	0.50	8.61
<b>Average</b>	34650	202170	2.33	2.09	9.68	0.20	0.13	7.59

## Salmon Creek Wastewater Treatment Plant Flow and Rainfall Report

Date	Hockinson GPD	Meadow Glade GPD	Total BG Inf MGD	BG Only Inf MGD	SC Inf MGD	BG Rainfall	SC Rainfall	District Total Inf MGD
12/1/2025	35800	198600	2.16	1.93	9.48	0.01	0.01	7.55
12/2/2025	38700	212400	2.10	1.85	9.12	0.01	0.01	7.27
12/3/2025	34800	216200	2.03	1.78	8.99	0.01	0.01	7.21
12/4/2025	63100	266100	3.07	2.75	10.02	1.87	0.69	7.27
12/5/2025	80600	309200	4.21	3.82	13.41	0.79	0.67	9.59
12/6/2025	46500	287700	3.53	3.20	12.44	0.28	0.05	9.24
12/7/2025	45000	303900	3.44	3.09	12.05	0.27	0.57	8.96
12/8/2025	106500	440200	5.53	4.99	12.93	3.05	1.77	7.94
12/9/2025	101000	398900	5.60	5.10	17.15	0.55	1.89	12.05
12/10/2025	65500	284500	4.04	3.69	14.56	0.03	0.88	10.87
12/11/2025	56100	240700	3.40	3.10	13.26	0.13	0.00	10.16
12/12/2025	51200	243100	3.28	2.98	12.54	0.01	0.00	9.56
12/13/2025	31200	209800	2.72	2.48	11.03	0.01	0.00	8.55
12/14/2025	34300	241200	2.83	2.56	10.77	0.75	0.00	8.21
12/15/2025	58300	281200	3.35	3.01	12.02	0.15	0.44	9.01
12/16/2025	0	227600	3.26	3.04	11.51	0.44	0.23	8.47
12/17/2025	0	214700	2.91	2.70	11.54	0.37	0.29	8.84
12/18/2025	195000	422900	5.10	4.48	14.33	1.63	2.09	9.85
12/19/2025	65400	281900	3.90	3.56	15.19	0.05	0.08	11.63
12/20/2025	39400	248100	3.31	3.02	13.65	0.01	0.02	10.63
12/21/2025	36000	243900	3.15	2.87	12.09	0.16	0.06	9.22
12/22/2025	39000	226800	2.97	2.70	11.51	0.34	0.15	8.81
12/23/2025	33700	222700	2.82	2.56	11.48	0.02	0.21	8.92
12/24/2025	35400	224800	2.73	2.47	11.31	0.10	0.04	8.84
12/25/2025	29600	221800	2.61	2.36	10.17	0.08	0.15	7.81
12/26/2025	28400	205500	2.51	2.28	10.40	0.17	0.19	8.12
12/27/2025	29400	206900	2.46	2.23	10.26	0.04	0.05	8.03
12/28/2025	26400	219800	2.47	2.23	10.17	0.00	0.00	7.94
12/29/2025	27100	197400	2.30	2.08	10.04	0.00	0.00	7.96
12/30/2025	23900	204600	2.28	2.05	9.79	0.00	0.00	7.74
12/31/2025	23700	194200	2.10	1.88	9.83	0.02	0.00	7.95
<b>Total</b>	1481000	7897300	98.19	88.81	363.04	11.35	10.55	274.23
<b>Min</b>	0	194200	2.03	1.78	8.99	0.00	0.00	7.21
<b>Max</b>	195000	440200	5.60	5.10	17.15	3.05	2.09	12.05
<b>Average</b>	47774	254752	3.17	2.86	11.71	0.37	0.34	8.85

\* 12/16-12/17 - Flow reported in a three day total on 12/18



## APPENDIX D

### ERU AND SEWER LINE DATA



**CLARK REGIONAL WASTEWATER DISTRICT  
SALMON CREEK TREATMENT PLANT  
SEWER CONNECTION REPORT**

Year: Jan 2025 - Dec 2025

Month	New Residential	Total Residential	Multi Family/ Guesthomes (*8)	Total Res/ Multi-Family	New Commercial	Total Commercial	Grand Total ERU's	Line Construction		Total Line Construction	Total Miles	Year to Date	
								Developer	District			ERU'S	SCTP - All
<b>Balance Forward</b>		29090.8		8160.9		4768.6	42020.3			2426978	459.6	Res	650.0
<b>Jan</b>	42.0	29132.8	0.6 ♦	8161.5	9.0 ♦	4777.6	42071.9	329	0	2427307	459.7	Multi-Family	473.6 (Actual)
<b>Feb</b>	28.0	29160.8	0.6 ♦	8162.1	5.7 ♦	4783.3	42106.2	397	0	2427704	459.8	Comm	82.2
<b>Mar</b>	28.0	29188.8	0.0	8162.1	1.0 ♦	4784.3	42135.2	0	0	2427704	459.8	<b>Total</b>	<b>1,205.8</b>
<b>Apr</b>	23.0	29211.8	38.4 ♦	8200.5	0.3 ♦	4784.6	42196.9	767	0	2428471	459.9	<b>VTP</b>	
<b>May</b>	16.0	29227.8	0.0	8200.5	3.1 ♦	4787.7	42216.0	4342	0	2432813	460.8	Res	8.0
<b>Jun</b>	12.0	29239.8	0.6 ♦	8201.1	5.9 ♦	4793.6	42234.5	8	0	2432821	460.8	Multi-Family	1.2 (Actual)
<b>Jul</b>	8.0	29247.8	59.6 ♦	8260.7	15.5 ♦	4809.1	42317.6	4105	0	2436926	461.5	Comm	1.5
<b>Aug</b>	18.0	29265.8	0.0	8260.7	0.4 ♦	4809.5	42336.0	0	0	2436926	461.5	<b>Total</b>	<b>10.7</b>
<b>Sep</b>	37.0	29302.8	29.6 ♦	8290.3	0.1 ♦	4809.6	42402.7	11555	0	2448481	463.7	<b>RTP</b>	
<b>Oct</b>	31.0	29333.8	230.6 ♦	8520.9	3.4 ♦	4813.0	42667.7	4837	0	2453318	464.6	Res	41.0
<b>Nov</b>	29.0	29362.8	0.6 ♦	8521.5	4.3 ♦	4817.3	42701.6	4079	0	2457397	465.4	Multi-Family	- (Actual)
<b>Dec</b>	18.0	29380.8	111.6 ♦	8633.1	5.9 ♦	4823.2	42837.1	968	0	2458365	465.6	Comm	-
<b>Subtotals</b>	290.0		472.2		54.6			31387	0			<b>Total</b>	<b>41.0</b>
<b>Total ERU's</b>		29380.8		8633.1		4823.2	42837.1			2458365	465.6	<b>Permits</b>	
												SCTP	699
												RTP	41
												VTP	8
												<b>Total</b>	<b>748</b>

♦ See next page for explanation

D





**CLARK REGIONAL WASTEWATER DISTRICT  
URBAN HOLDING  
SALMON CREEK TREATMENT PLANT  
SEWER CONNECTION REPORT**

Year: Jan 2025 - Dec 2025

Month	New Residential	Total Residential	Multi Family/ Guesthomes (* .8)	Total Res/ Multi-Family	New Commercial	Total Commercial	Grand Total ERU's	Line Construction		Total Line Construction	Total Miles
	ERU's							Developer	District		
<b>Balance Forward</b>		567.0		0.0		0.0	567.0			60573	11.5
<b>Jan</b>	23.0	590.0	0.0	0.0	0.0	0.0	590.0	0	0	60573	11.5
<b>Feb</b>	16.0	606.0	0.0	0.0	0.0	0.0	606.0	4093	0	64666	12.2
<b>Mar</b>	12.0	618.0	0.0	0.0	0.0	0.0	618.0	0	0	64666	12.2
<b>Apr</b>	15.0	633.0	0.0	0.0	0.0	0.0	633.0	0	0	64666	12.2
<b>May</b>	13.0	646.0	0.0	0.0	0.0	0.0	646.0	0	0	64666	12.2
<b>Jun</b>	23.0	669.0	0.0	0.0	0.0	0.0	669.0	0	0	64666	12.2
<b>Jul</b>	2.0	671.0	0.0	0.0	0.0	0.0	671.0	0	0	64666	12.2
<b>Aug</b>	5.0	676.0	0.0	0.0	0.0	0.0	676.0	0	0	64666	12.2
<b>Sep</b>	17.0	693.0	0.0	0.0	0.0	0.0	693.0	2119	0	66785	12.6
<b>Oct</b>	20.0	713.0	0.0	0.0	0.0	0.0	713.0	0	0	66785	12.6
<b>Nov</b>	1.0	714.0	0.0	0.0	0.0	0.0	714.0	6123	0	72908	13.8
<b>Dec</b>	8.0	722.0	0.0	0.0	0.0	0.0	722.0	0	0	72908	13.8
<b>Subtotals</b>	155.0		0.0		0.0			12335	0		
<b>Total ERU's</b>		722.0		0.0		0.0	722.0			72908	13.8

D

<b>January</b>	
SCTP Existing home New ADU ◆ 13512 NE 49th Ct	<u>0.6</u> 0.6
SCTP Hazel Dell Towncenter Bldg B1 9303 NE 5th Ave ◆ Phoenix Salon	2.7
SCTP Bowyers Marketplace Ph 2 12210 NE 117th Ave ◆ Brush Prairie Car Wash	<u>6.3</u> 9.0
<b>February</b>	
SCTP Existing home New ADU ◆ 412 NW 83rd St	<u>0.6</u> 0.6
SCTP Macklins Site Plan ◆ 11601 NE 126th St	4.2
SCTP Skyview Station 14105 NE 10th Ave ◆ Jersey Mike's	<u>1.5</u> 5.7
<b>March</b>	
SCTP Wyatt Sewer Connection ◆ 5801 NE 88th St	<u>1.0</u> 1.0
<b>April</b>	
SCTP Hamlet at Curtin Creek ◆ 6901 NE 131st Way	<u>38.4</u> 38.4
SCTP Salmon Creek Plaza 13023 NE Hwy 99 # 9 ◆ Pho 4 Seasons	<u>0.3</u> 0.3

<b>May</b>	
SCTP Curtin Creek Park ◆ 12603 NE 72nd Ave	2.1
SCTP Bowyer's Market Place 11512 NE 119th St ◆ Les Schwab	<u>1.0</u> 3.1
<b>June</b>	
SCTP Existing House New ADU ◆ 15008 NW 16th Ave	<u>0.6</u> 0.6
SCTP Skyview Station 14015 NE 10th Ave ◆ Habit Burger Grill	5.2
SCTP Hazel Dell Towncenter Bldg F 8810 NE 5th Ave ◆ Emler Swim School	<u>0.7</u> 5.9
<b>July</b>	
SCTP Existing home New ADU ◆ 2204 NW 110th Cir	0.6
SCTP Existing home New ADU ◆ 1814 NE 99th St	0.6
SCTP 90th St Site Plan 4400 NE 89th Way ◆ Apartments	<u>58.4</u> 59.6
SCTP 90th St Site Plan 4400 NE 89th Way ◆ Office	1.0
SCTP DSHS Clark County ◆ 16015 NE 50th Ave	12.0
SCTP Nielsen Industrial 11438 NE 128th St ◆ Koval Trucking	1.0
SCTP Orchards Plaza 11608 NE 76th St ◆ Red Leaf Coffee	<u>1.5</u> 15.5

<b>August</b>	
SCTP Totem Pole Shopping Center 7907 NE Highway 99 ◆ The Dollar Tree Store	<u>0.4</u> 0.4
<b>September</b>	
SCTP Bella Meadows Apartments 8515 NE St Johns Rd ◆ Apartments	27.2
SCTP Existing home New ADU ◆ 13220 NW 42nd Ct	0.6
SCTP Existing home New ADU ◆ 11002 NE 54th Ave	0.6
SCTP Existing home 2 New ADUs ◆ 6510 NE 102nd Ave	<u>1.2</u> 29.6
<b>October</b>	
SCTP Existing home <b>AND</b> new ADU ◆ 1814 NE 146th St	1.6
SCTP Existing home New ADU ◆ 13802 NW 20th Ct	0.6
SCTP Existing home New ADU ◆ 8500 NE 88th St	0.6
SCTP Existing home New ADU ◆ 16516 NE 27th Ct	0.6
SCTP Prose Walnut Grove Apartments 6712 NE 88th St ◆ Apartments	<u>227.2</u> 230.6
SCTP Nielsen Industrial Lots 15 & 16 ◆ 11406 NE 126th St	0.6
SCTP Prose Walnut Grove Apartments 6712 NE 88th St ◆ <b>Pool &amp; Office</b>	<u>2.8</u> 3.4

<b>November</b>	
SCTP Existing home New ADU ◆ 5804 NE 111th Cir	<u>0.6</u> 0.6
SCTP Brush Prairie Church ◆ 11801 NE 112th Ave	<u>4.3</u> 4.3
<b>December</b>	
SCTP Existing home New ADU ◆ 11101 NE 5th Ave	0.6
SCTP Existing home <b>AND</b> 2 new ADUs ◆ 13410 NE 12th Ave	2.2
SCTP Jailens Point Apartments 7011 NE 126th st ◆ Apartments	60.8
SCTP Jailens Point Apartments West 6811 NE 126th St ◆ Apartments	<u>48</u> 111.6
SCTP Nielsen Industrial Lots 15 & 16 ◆ 11406 NE 126th St	0.4
SCTP Jailens Point Apartments 7011 NE 126th st ◆ <b>Pool &amp; Office</b>	2
SCTP Skyview Station - Mt Mikes Pizza ◆ 14109 NE 10TH AVE	<u>3.5</u> 5.9

**CLARK REGIONAL WASTEWATER DISTRICT  
MEADOWGLADE  
SALMON CREEK TREATMENT PLANT  
SEWER CONNECTION REPORT**

Year: Jan 2025 - Dec 2025

Month	New Residential	Total Residential	Multi Family/ Guesthomes (*.8)	Total Res/ Multi-Family	New Commercial	Total Commercial	Grand Total ERU's	Line Construction		Total Line Construction	Total Miles
	ERU's							Developer	District		
<b>Balance Forward</b>		762.0		6.4		185.4	953.8			30855	5.8
<b>Jan</b>	0.0	762.0	0.0	6.4	0.0	185.4	953.8	0	0	30855	5.8
<b>Feb</b>	0.0	762.0	0.0	6.4	0.0	185.4	953.8	0	0	30855	5.8
<b>Mar</b>	0.0	762.0	0.0	6.4	0.0	185.4	953.8	0	0	30855	5.8
<b>Apr</b>	0.0	762.0	0.0	6.4	0.0	185.4	953.8	0	0	30855	5.8
<b>May</b>	0.0	762.0	1.4 ♦	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Jun</b>	0.0	762.0	0.0	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Jul</b>	0.0	762.0	0.0	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Aug</b>	0.0	762.0	0.0	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Sep</b>	0.0	762.0	0.0	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Oct</b>	0.0	762.0	0.0	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Nov</b>	0.0	762.0	0.0	7.8	0.0	185.4	955.2	0	0	30855	5.8
<b>Dec</b>	1.0	763.0	0.0	7.8	0.0	185.4	956.2	0	0	30855	5.8
<b>Subtotals</b>	1.0		1.4		0.0			0	0		
<b>Total ERU's</b>		763.0		7.8		185.4	956.2			30855	5.8

♦ See next page for explanation

**May**

SCTP M Existing home New ADU

◆ 9802 NE 191st St 0.6

SCTP M Hardship Mobile Home

◆ 11701 NE 185th Street 0.8  
1.4





**CLARK REGIONAL WASTEWATER DISTRICT  
HOCKINSON  
SALMON CREEK TREATMENT PLANT  
SEWER CONNECTION REPORT**

Year: Jan 2025 - Dec 2025

Month	New Residential	Total Residential	Multi Family/ Guesthomes (* .8)	Total Res/ Multi-Family	New Commercial	Total Commercial	Grand Total ERU's	Line Construction		Total Line Construction	Total Miles
	ERU's							Developer	District		
<b>Balance Forward</b>		77.0		0.0		139.1	216.1			7061.0	1.3
<b>Jan</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Feb</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Mar</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Apr</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>May</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Jun</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Jul</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Aug</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Sep</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Oct</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Nov</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Dec</b>	0.0	77.0	0.0	0.0	0.0	139.1	216.1	0.0	0.0	7061.0	1.3
<b>Subtotals</b>	0.0		0.0		0.0			0.0	0.0		
<b>Total ERU's</b>		77.0		0.0		139.1	216.1			7061	1.3

D-



**CLARK REGIONAL WASTEWATER DISTRICT  
RIDGEFIELD AREA  
SALMON CREEK TREATMENT PLANT  
SEWER CONNECTION REPORT**

Year: Jan 2025 - Dec 2025

Month	New Residential ERU's	Total Residential	Multi Family/ Guesthomes (* .8)	Total Res/ Multi-Family	New Commercial	Total Commercial	Grand Total ERU's	Line Construction		Total Line Construction	Total Miles
								Developer	District		
<b>Balance Forward</b>		3566.0		400.0		399.1	4365.1			359529.0	68.1
<b>Jan</b>	30.0	3596.0	0.0	400.0	0.0	399.1	4395.1	0.0	0.0	359529.0	68.1
<b>Feb</b>	17.0	3613.0	0.0	400.0	0.0	399.1	4412.1	4102.0	0.0	363631.0	68.9
<b>Mar</b>	23.0	3636.0	0.0	400.0	0.0	399.1	4435.1	0.0	0.0	363631.0	68.9
<b>Apr</b>	14.0	3650.0	0.0	400.0	2.0 ♦	401.1	4451.1	0.0	0.0	363631.0	68.9
<b>May</b>	11.0	3661.0	0.0	400.0	3.4 ♦	404.5	4465.5	141.0	0.0	363772.0	68.9
<b>Jun</b>	14.0	3675.0	0.0	400.0	1.0 ♦	405.5	4480.5	117.0	0.0	363889.0	68.9
<b>Jul</b>	20.0	3695.0	0.0	400.0	2.1 ♦	407.6	4502.6	0.0	0.0	363889.0	68.9
<b>Aug</b>	15.0	3710.0	0.0	400.0	1.0 ♦	408.6	4518.6	0.0	0.0	363889.0	68.9
<b>Sep</b>	20.0	3730.0	0.0	400.0	6.0 ♦	414.6	4544.6	6973.0	0.0	370862.0	70.2
<b>Oct</b>	13.0	3743.0	0.0	400.0	0.0	414.6	4557.6	0.0	0.0	370862.0	70.2
<b>Nov</b>	13.0	3756.0	0.0	400.0	0.0	414.6	4570.6	4073.0	0.0	374935.0	71.0
<b>Dec</b>	14.0	3770.0	0.0	400.0	12.1 ♦	426.7	4596.7	882.0	0.0	375817.0	71.2
<b>Subtotals</b>	204.0		0.0		27.6			0.0	0.0		
<b>Total ERU's</b>		3770.0		400.0		426.7	4596.7			375817	71.2

♦ See next page for explanation

D-



**April**

SCTP R Pioneer Village Ph 2	
4403 S Settler Dr	
◆ Shell Bldg 16	1.0
SCTP R Pioneer Village Ph 2	
4419 S Settler Dr	
◆ Shell Bldg 15	<u>1.0</u>
	2.0

**May**

SCTP R Union Ridge Town Center	
100 N 56th Pl	
◆ Starbucks	1.9
SCTP R Union Ridge Town Center	
200 N 56th Pl	
◆ Chipotle Grill	<u>1.5</u>
	3.4

**June**

SCTP R IQ Credit Union	
◆ 5304 Pioneer St	<u>1.0</u>
	1.0

**July**

SCTP R Sanderling Park	
4530 S Green Pastures Dr	
◆ Community Center and Pool	<u>2.1</u>
	2.1

**August**

SCTP R Holsinger Mixed Use	
536 S Royle Rd	
◆ Shell Bldg A -B	<u>1.0</u>
	1.0

**September**

SCTP R McDonald's Ridgefield	
5804 Pioneer St	3.0
SCTP R Hillhurst Commercial	
2205 S Hillhurst Rd	
◆ Shell Bldg A-C	<u>3.0</u>
	6.0

**December**

SCTP R Ridgefield Gateway Ph1	
◆ 5714 Pioneer St	1.2
SCTP R Discovery Ridge Ph 3	
411 S 47th Ave	
◆ Wash Kings Ridgefield	6.3
SCTP R Union Ridge Town Center - Pad G	
◆ 5708 Pioneer St	1
SCTP R Union Ridge Town Center - Pad I	
◆ 5708 Pioneer St	1
SCTP R Union Ridge Town Center - Pad J	
◆ 5708 Pioneer St	1
SCTP R Union Ridge Town Center - Pad J Add'l ERU	
◆ 5708 Pioneer St	0.6
SCTP R Union Ridge Town Center - Pad K	
◆ 5708 Pioneer St	<u>1</u>
	12.1



D-

